





## SERVICE ENTRANCE/ANCHOR BOLT LAYOUT

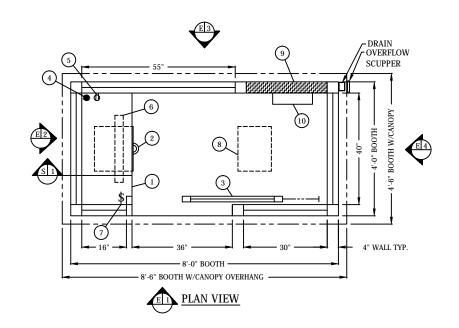








4" WALL SECTION -2" X 2" GALV. STEEL TUBE BASE MEMBER CONTINUOUS WELD 4 SIDES STAINLESS STEEL 5/8" POWER FASTENERS "POWER-STUD" ANCHOR BOLT 41/2" LENGTH CAT. NO. 7332 2" X 2" X 2" X 2" X ¼" ANGLE IRON ¬ ANCHOR CLIP, ONE EACH CORNER

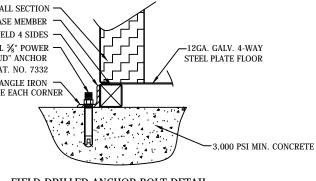

THIS DRAWING IS FOR REFERENCE PURPOSES ONLY. PAR-KUT BUILDINGS MUST BE SECURELY ANCHORED IN PLACE AND ELECTRICAL SYSTEM MUST BE PROPERLY GROUNDED. ADEQUATE SIZED ANCHOR BOLTS SHALL BE USED. THE SIZE AND DEPTH OF THE ANCHORS SHOULD BE OF SUFFICIENT DESIGN TO WITHSTAND THE HIGHEST RECORDED WIND SPEEDS/SEISMIC DESIGN CATEGORY IN THE AREA OF INSTALLATION. CONSULT A PROFESSIONAL ENGINEER FAMILIAR WITH THE WEATHER CONDITIONS IN THE AREA.

- a.  $\frac{3}{4}$ " RIGID COUPLING THROUGH WALL FOR ELECTRICAL SERVICE ENTRANCE TO C.B. PANEL.
- 2" X 2" X  $\chi$ "(MIN) STEEL ANCHOR CLIP WITH A  $\chi$ " ANCHOR BOLT HOLE, 4-REQ'D. ONE EACH CORNER. ANCHOR BUILDING AFTER FINAL LOCATION. ANCHOR BOLTS NOT INCLUDED.
- OUTER EDGE OF BUILDING
- SUGGESTED MINIMUM FOUNDATION/SLAB. Ь

## GENERAL SITE INSTALLED ITEMS PROVIDED BY OTHERS

- 1. PROVIDE 120V/240V. SINGLE PHASE. 3-WIRE SERVICE WITH GROUND.
- CONCRETE FOUNDATION/SLAB MINIMUM 6" DEEP, 3,000 PSI MINIMUM (28 2. DAY ACI 318). THE FOUNDATION/SLAB SHOULD BE A MINIMUM OF 24" WIDER THAN THE BUILDING FOOT PRINT DIMENSIONS. THIS IS TO PROVIDE A 12" CONCRETE BORDER ON EACH SIDE OF THE BUILDING
- ADEQUATE SIZE DRILLED ANCHOR BOLTS. SUGGESTED SIZE: 5/8" X 41/2" POWER FASTENERS "POWER STUD" CATALOG #7332.
- COUNTER 18" DEEP PAINTED GALVANIZED STEEL MOUNTED AT SILL. 1.
- PAINTED STORAGE DRAWER.
- DOOR 36" WIDE SLIDING STEEL WITH WEATHER-STRIPPING, BALL BEARING HANGERS, HEAVY DUTY TRACK, SAFETY GLAZING, HOOK BOLT LOCK, AND HARDWARE
- 2" DIAMETER HOLE FOR DROP CORDS
- DUPLEX OUTLET MOUNTED BELOW COUNTER.
- CODE COMPLIANT LIGHT FIXTURE.
- WALL SWITCH FOR LIGHT FIXTURE
- FAN FORCED HEATER RECESSED MOUNTED IN CEILING. 9. 3/4" RIGID COUPLING THOUGH WALL TO CIRCUIT BREAKER PANEL FOR ELECTRICAL SERVICE ENTRANCE.
- CIRCUIT BREAKER PANEL- 12 SPACE, 120/240V, 1 Ø-3 WIRE WITH GROUND. 100 AMP MAIN BREAKER INCLUDED. ALL BRANCH BREAKERS FOR FACTORY INSTALLED DEVICES PROVIDED

NOTE: PAR-KUT BOOTHS ARE OF SINGLE UNIT WELDED STEEL CONSTRUCTION, FACTORY ASSEMBLED AND DELIVERED SET UP. FAILURE TO SECURELY ANCHOR BOOTH MAY RESULT IN OVERTURNING OF UNIT AND SERIOUS INJURY TO OCCUPANT

- GLAZING TEMPERED SAFETY GLAZING SET IN PAINTED STEEL EXTERIOR A. WINDOW FRAMES WITH REMOVABLE ALUMINUM INTERIOR GLAZING STOPS.
- PAINT- FINISH SHALL BE SINGLE COLOR OF CHOICE, IMRON POLYURETHANE HIGH GLOSS INDUSTRIAL COATING. SHALL BE APPLIED TO ALL EXPOSED METAL SURFACES. THIS EXCLUDES FLOOR, ROOF SURFACE, AND ANY STAINLESS STEEL COMPONENTS (IF USED).
- ELECTRICAL- ALL WIRING BY PAR-KUT TO BE #12(MIN) STRANDED COPPER, C. THHN ENCLOSED IN  $\not\boxtimes$ "(MIN) E.M.T. PER NATIONAL ELECTRIC CODE. ALL ELECTRICAL EQUIPMENT WILL BE LISTED BY U.L. OR EQUIVALENT RECOGNIZED NATIONAL TESTING LABORATORY. ALL WIRING TO TERMINATE AT C.B. PANEL. ALL CIRCUITS HAVE GREEN GROUND WIRE.
- BOOTH WILL HAVE A 3" CANOPY OVERHANG ON ALL SIDES. D.
- LIFTING RING(S) ARE PROVIDED ON ROOF. NO ON SITE WORK BY PAR-KUT.

SATISFY APPLICABLE CODES

G ACTUAL LOCATION OF ELECTRICAL DEVICES MAY VARY DUE TO INSTALLATION CONSTRAINTS, SHIPPING RESTRICTIONS, OR FOR PROPER PLACEMENT TO

INSULATION -

14GA. GALV. STEEL ROOF, CANOPY, AND CEILING

2" X 4" GALV. STEEL TUBE

CODE COMPLIANT LIGHT FIXTURE

PAINTED STEEL WINDOW FRAME

TEMPERED SAFETY GLAZING ·

14GA. PAINTED GALV. STEEL COUNTER -

PAINTED STORAGE DRAWER

DUPLEX OUTLET

18GA. GALV. STEEL INNER PANEL INSULATION

14GA. GALV. STEEL OUTER PANEL

12GA. GALV. 4-WAY DIAMOND PLATE STEEL FLOOR 2" X 2" GALV. STEEL TUBE BASE

BOOTH PAINT COLOR:
GLAZING TINT COLOR:
(P)
OVEDALL SHIDDING DIMEN

OVERALL SHIPPING DIMENSIONS: \_\_\_\_\_\_ ESTIMATED WEIGHT: \_\_\_\_\_2,000 LBS.

## FIELD DRILLED ANCHOR BOLT DETAIL NO SCALE

